


Hydrogen Sulfide: EPI v. Control

P value = 95% confidence

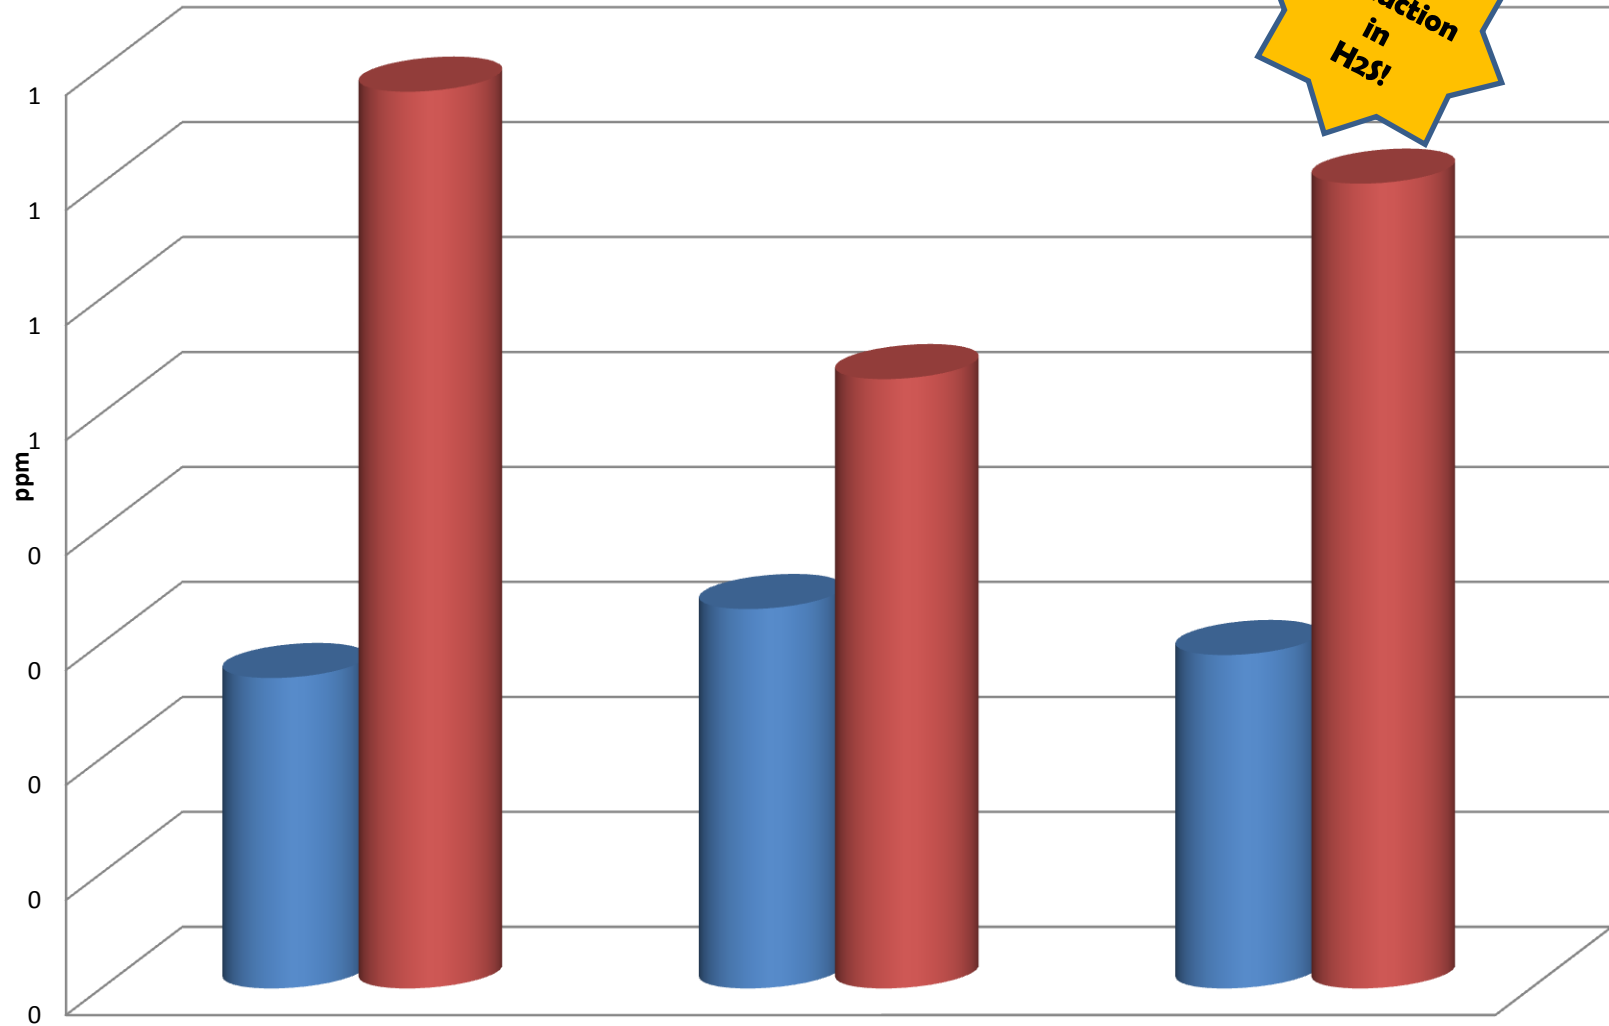

■ EPI
■ Control

Turn 1
0.27
0.78

Turn 2
0.33
0.53

Total
0.29
0.70

**58.6%
Reduction
in
H₂S!**